

WORK SAFELY

If the construction phase of your project might result in workers or equipment operating within 7 metres of an overhead power line, you must contact EPCOR at **safetycodes@epcor.com** or **780-412-4450** before beginning any work.

FOR MORE INFORMATION

To book a power line safety awareness session, please contact EPCOR's Public Safety Advisor at 780-412-7711. Additional power line safety resources can be found at epcor.com or wherestheline.ca.



EPCOR respects your right to privacy. Any personal information we collect about you, including your name, address, phone number and e-mail address will only be used in regards to this project. For more information, please see EPCOR's Privacy Policy at epcor.com.

The EPCOR logo, featuring the word "EPCOR" in white capital letters on a dark blue square background.



INFILL DEVELOPMENT AND CLEARANCE REQUIREMENTS AROUND OVERHEAD POWER LINES


Before you finalize your lot development and building plans ensure they meet the Alberta Electrical Utility Code's clearance requirements.¹

IMPORTANCE OF MINIMUM CLEARANCE REQUIREMENTS

Overhead power lines can be dangerous because there is usually no protection on the wire. Electricity looks for the shortest path to the ground, so if a person gets too close to an overhead power line they can be its path to the ground. This may cause serious injury or death.

Ensuring minimum clearance between power lines and any structures (e.g. buildings, signage, light standards, etc.) will help reduce the risks associated with being in close proximity to electrical infrastructure.

MINIMUM CLEARANCE REQUIREMENTS FOR STRUCTURES AND OVERHEAD POWER EQUIPMENT

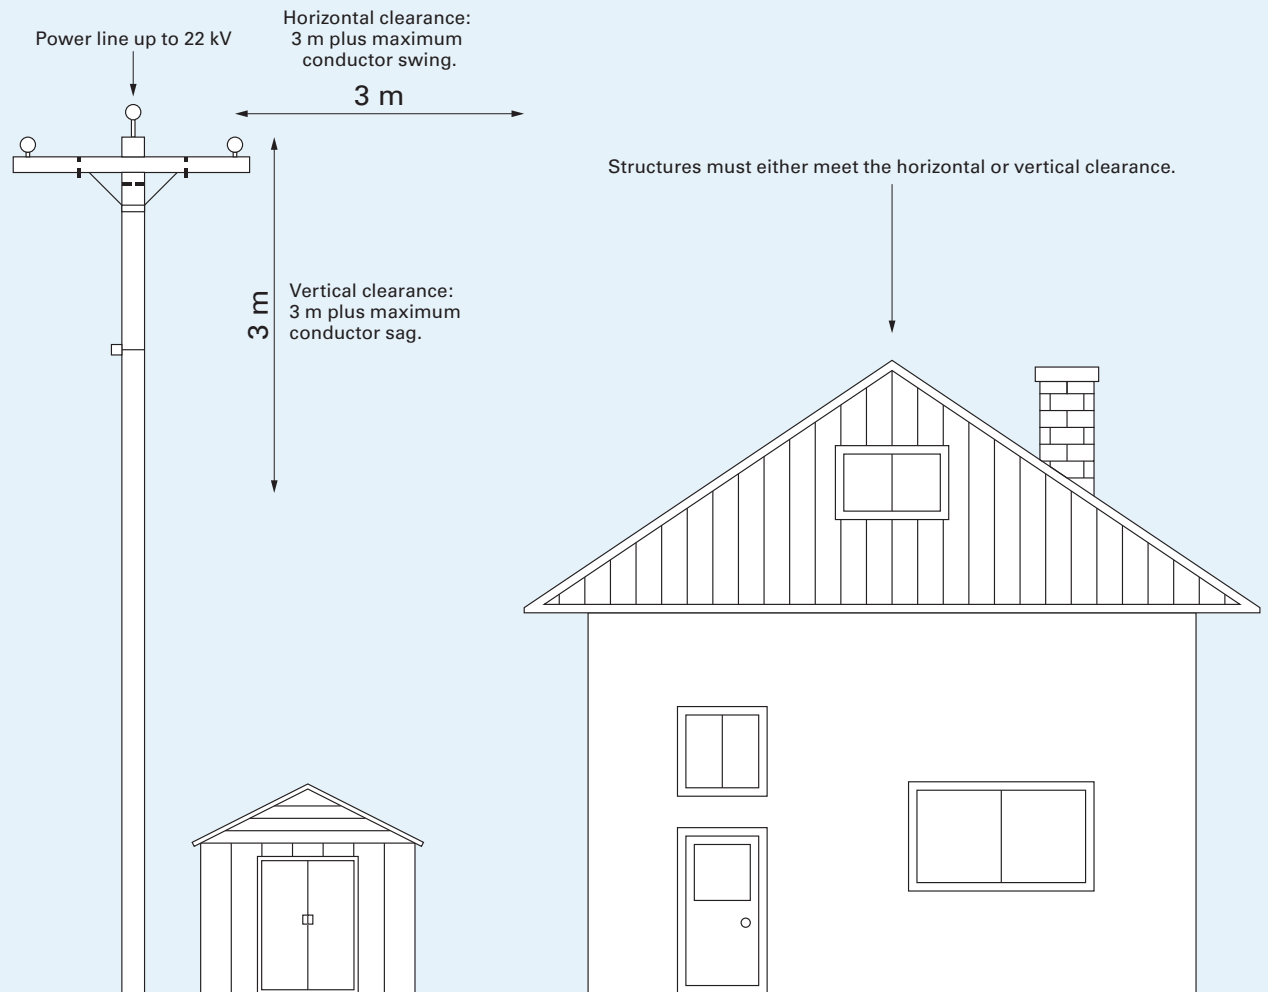

¹Alberta Electrical Utility Code, Table 7 – Minimum Design Clearances from Wires and Conductors Not Attached to Buildings, Signs, and Similar Plant (April 2016).

The illustrated clearance requirements reflect the Alberta Electrical Utility Code (2016). It is your responsibility to ensure compliance with the latest version of the Alberta Electrical Utility Code.